


**FOUNDATION PLAN NOTES.**

1. SEE SHEET 605 FOR FOUNDATION PLAN NOTES.
2. MULTIPLE SLAB ELEVATIONS AND SLOPE TO DRAIN IN SHADDED AREA. COORDINATE W/ ARCH. AND PLUMBING DWGS.
3. EXHIBIT CONSTRUCTION JOINT PATTERN, NOT SHOWN IN THIS AREA FOR CLARITY. PATTERN SHALL BE AS PRESCRIBED IN NOTE BOOK ON SHEET 605.



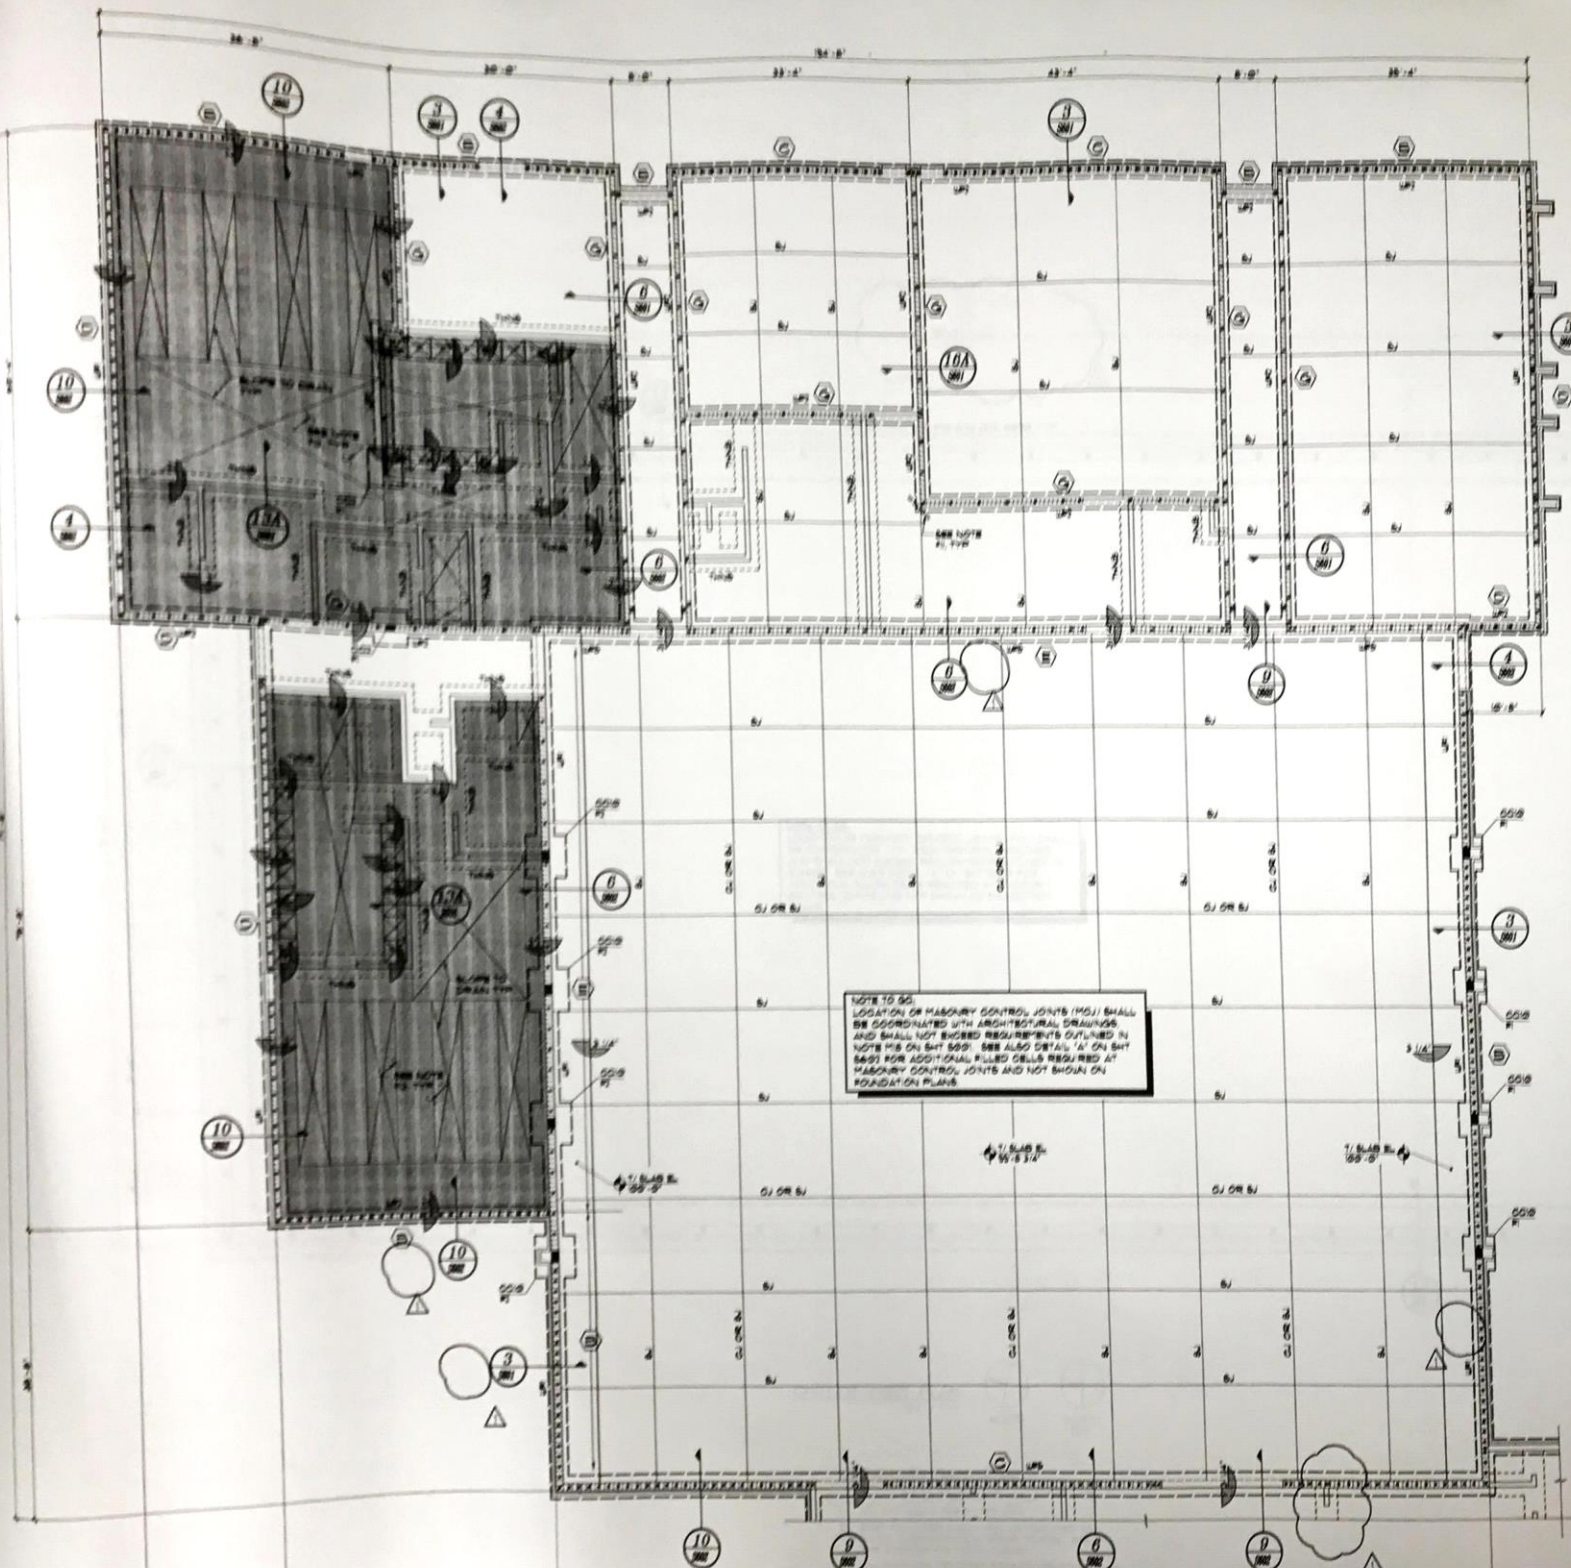

NOTE TO GO:  
 LOCATION OF MASONRY CONTROL JOINTS (MCJ) SHALL  
 BE COORDINATED WITH ARCHITECTURAL DRAWINGS  
 AND SHALL NOT EXCEED REQUIREMENTS OUTLINED IN  
 NOTE #16 ON SHT 500. SEE ALSO DETAIL 'A' ON SHT  
 500 FOR ADDITIONAL FILLED CELLS REQUIRED AT  
 MASONRY CONTROL JOINTS AND NOT SHOWN ON  
 FOUNDATION PLANS.

- FOUNDATION PLAN NOTES:**
- FLOOR SLAB SHALL BE 8" THICK CONCRETE REINFORCED WITH #4 @ 18" ON CENTER. SEE SLAB ON GRADE DETAILS FOR PLACEMENT OF REBAR.
  - REINFORCED CONCRETE IS AN ACCEPTABLE ALTERNATIVE TO UNREINFORCED CONCRETE. REINFORCED CONCRETE SHALL BE 100% FINISH POLYPROPYLENE FIBER REINFORCED CONCRETE AT A RATE OF 1.0 LB/CY.
  - 1" SLAB BUT 100'-0" AND THEREAFTER ONLY. SEE CIVIL DWGS FOR ACTUAL ELEVATION.
  - 1" WALL FTG IS 18" x 18" TYP AND
  - MULTIPLE SLAB ELEVATIONS AND SLOPE TO DRAIN TO SHADY AREA. COORDINATE W/ ARCH'L AND PLUMBING DWGS.
  - CGU WALL TYPES ARE AS INDICATED IN ARCH'L DWGS. TYP
  - STEP FTG WHERE SHOWN AND AS REQUIRED TO AVOID INTERFERENCE W/ OTHER TRACES. SEE TYP SHIPPED FTG DETAIL 11-54-51.
  - ALL FTGS ARE CENTERED BENEATH BEARING WALLS AND COLUMNS TYP AND
  - SEE SHEET 510 FOR CGU WALL REINFORCING SCHEDULE DESIGNATED AS (B) ON PLAN.
  - TYPICAL SPACING OF FILLED CELLS SHALL APPLY ABOVE AND BELOW OPERINGS ALSO.
  - SEE SHT 500 FOR GENERAL NOTES.
  - (3) 1/4" x 4'-0" LONG x 3'-0" DIA PLACED 1' CLEAR FROM CORNER CENTERED IN SLAB TYP.
  - MAINTAIN STRUCTURAL SLAB THICKNESS AT ALL FLOOR SLOPES AND DRAINAGES.
  - SHADY CONSTRUCTION JOINT PATTERN NOT SHOWN IN THIS AREA FOR CLARITY. PATTERN SHALL BE AS PRESCRIBED IN NOTE 5000 ON SHEET 500 FOR SLAB THICKNESS SPECIFIED.



KEY PLAN